


Reconfiguration Plan: TO21 RP 1

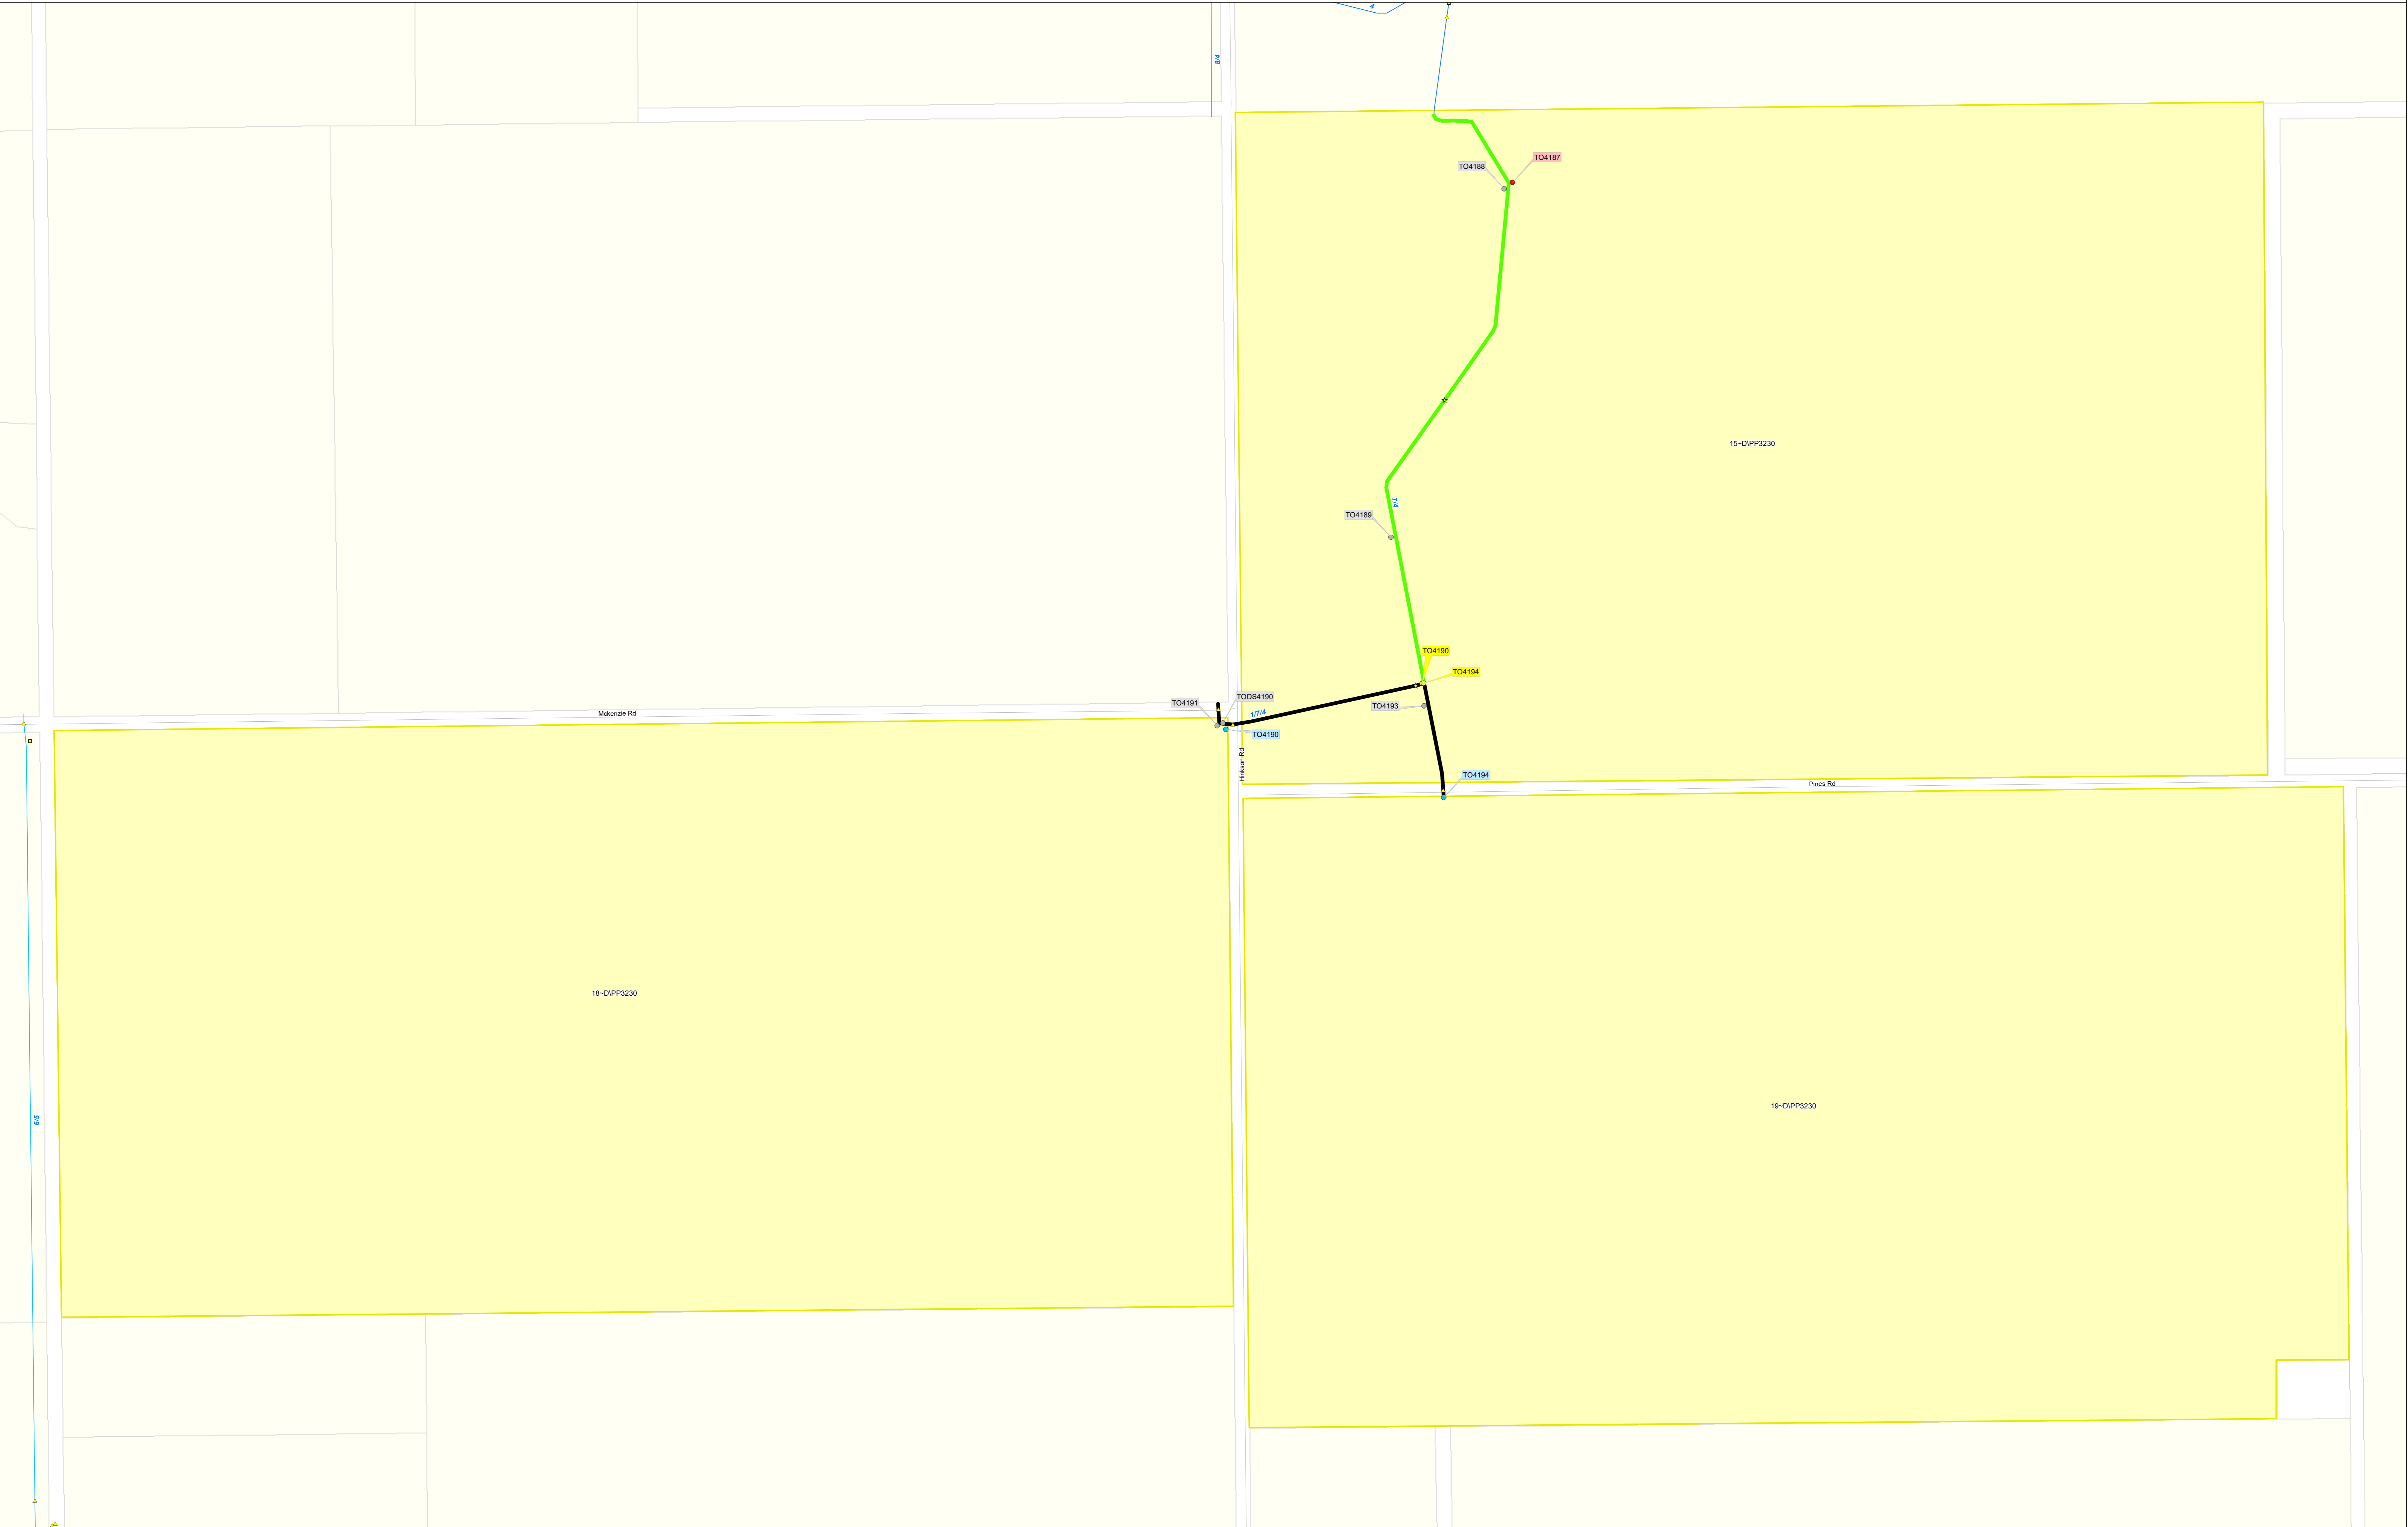

Goulburn-Murray WATER
IR185583
 24 May 2018
 GOULBURN-MURRAY WATER
 40 CASEY STREET (PO BOX 165)
 TATURA VIC 3616
 Ph (03) 5833 5500 Fax (03) 58245827
 gmsupport@gmwater.com.au

Service Point Modernisation Action	Channel Modernisation Action	GMW Irrigation Structures	Electrical Crossing	Oftake	Subway	Channel Network	Transport	Waterway	DCRP Customer Parcels
● Retain	— Retain channel with no modernisation	● Abandoned Structure	⚡ Electrical Crossing	◆ Outfall	▬ Subway	— Backbone Channel	— Freeway	— Waterway	■ DCRP Customer Parcels
● Relocate	— Retain channel with remediation	◆ Bridge	◆ Farm Irrigation Crossing	◆ Pump Station	▬ Valve - Isolation	— Non-Backbone	— Highway	■ Reservoir	■ Other Customer Properties
● Replace	— Retain channel with modernisation	▲ Culvert	● Flume	□ Regulator	▬ Weir	--- Decommissioned Channel	— Major Road	■ Lake	□ Property/Land Not Served
● Rationalise	— Pipeline	● Drainage Inlet	■ Footbridge	★ Regulator Combine	--- Pipeline	--- Minor Road			
● Relocation Point	— Decommission channel		■ Monitoring Station		--- Proposed Pipeline				

SCALE AT A0 1:2,840

0 0.05 0.1 0.2 km

The content of this product is provided for information purposes only. No claim is made as to the accuracy or authenticity of the content of the product. In no event will G.M.W. or its agents, instrumentalities and employees be liable for the accuracy of the information contained within this product nor its use of reliance placed on it. The information used within this product is provided on the basis that all persons accessing the information undertake responsibility for assessing the relevance and accuracy of its content.