

the easiest way  
to improve your livestock performances

**POLA**

1	<b>Environment</b> 25.8° Temperature 16.3° 32% Humidity 2462 ppb	<b>Animals</b> 12225 Females 22459 Total 10234 Males	6				
2	<b>Ventilation</b> 1 Active step 25.0° Set	<b>Weighing</b> 54Gr Plate 1 59Gr Average 64Gr Plate 2	7				
3	<b>Flap</b> 21P Pressure 20P Set	<b>Feeding</b> 70Gr Feed 2.01 Water/Feed 141Gr Water	8				
4	<b>Heating</b> 23.0° Set	<b>Distribution</b> At will Programmed 1234Kg Distributed	9				
5	<b>Radiant</b> 28.3° Temperature 28.0° Set	<b>Silo</b> 16122Kg Silo 1 15998Kg Silo 2	0				
ON Alarm   Settings   Installation   Archive   Check Control							
A	B	C	D	E	F	G	H


**Q farm**

## Qfarm makes the program user friendly



Wide display screen (7") with WVGA 800x480 dots resolution.

Each programming step comes with its help screen so the program has a "built in" handbook.

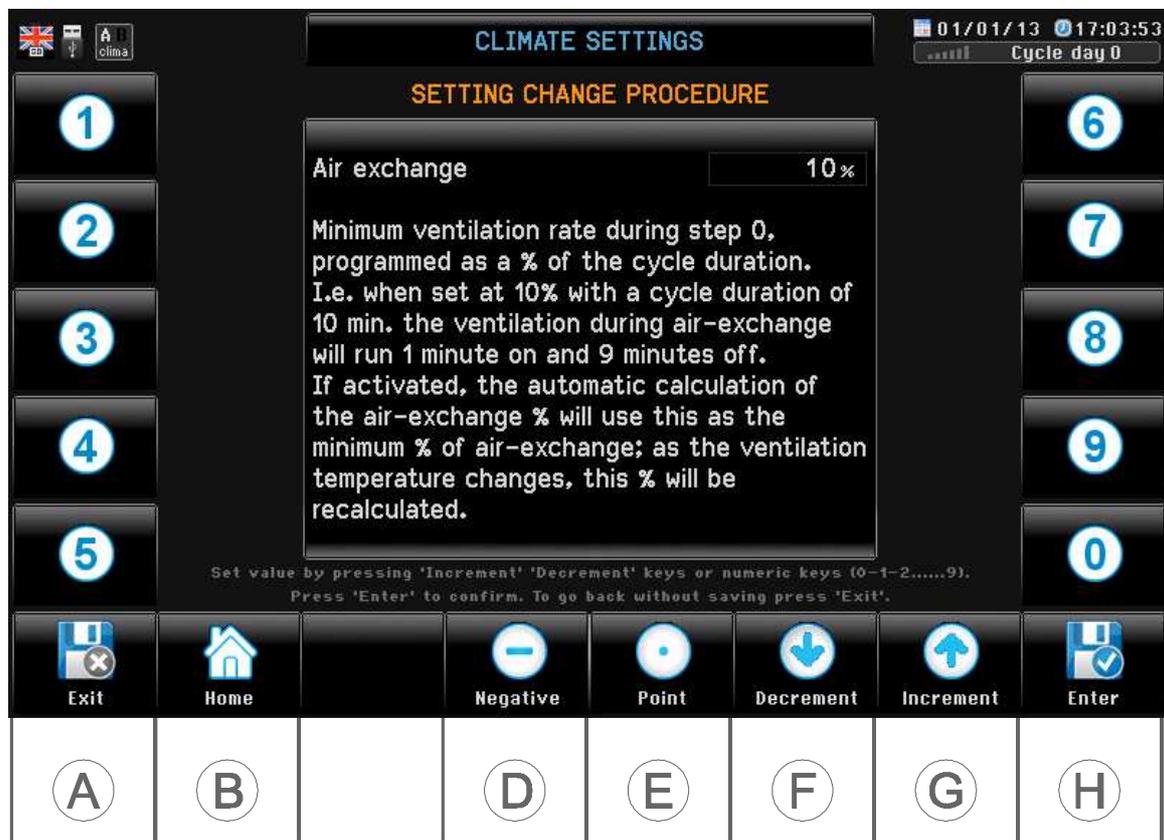

## Qfarm can manage both environmental control and feeding

The main **Qfarm** feature is that you can fully set and customize the house working configuration.

This is easily done connecting the **Qfarm** to a PC thru the **Qfarm Lab** software.

The **Qfarm** can manage up to 112 inputs, 108 on/off outputs, N. 44 0/10V outputs.

**Qfarm Lab** programming software has a step-by-step procedure with graphics and notes which enables you to define and configure the working parameters of the house.

Once the configuration has been completed, **Qfarm Lab** will print out the list of the components along with their wiring diagram.

Each complete house configuration is saved to a "program file" which is stored in the PC and transferred to **Qfarm** by USB pen drive. Program files can be recalled from **Qfarm** and edited at any time.

The program settings (temperature, relative humidity, etc.) and all the settings which are related to the house functioning are directly set by the **Qfarm**.

The **Qfarm** programming is assisted by HELP screenshots; while programming only the variables previously set by PC are shown. (i.e. If Heat 1 is the only option selected, the further heating options will not be shown. Same rule applies to flaps, cooling, ventilation, etc.).


### Summing up:

- The house configuration (number and type of Heaters, flaps, ventilators, etc.) is set by PC and uploaded to **Qfarm** via the **Qfarm Lab** software.
- The program settings related to the functioning of the system (temperature set, Relative Humidity set, etc.) is done directly on the **Qfarm**.

### Data transfer


Communication with external world is by USB pen drive.

The main programming parameters, the archive downloads and software updates can be made by PC connection via the USB pen drive.

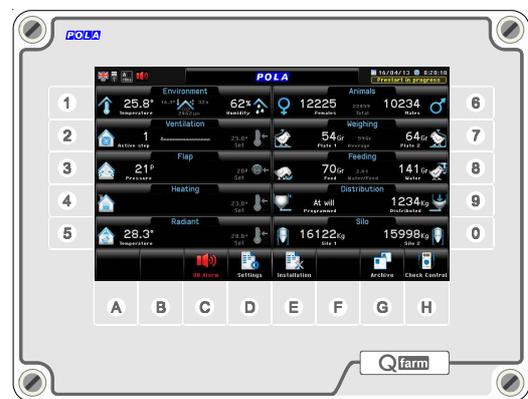

USB socket

## Qfarm can manage environmental control

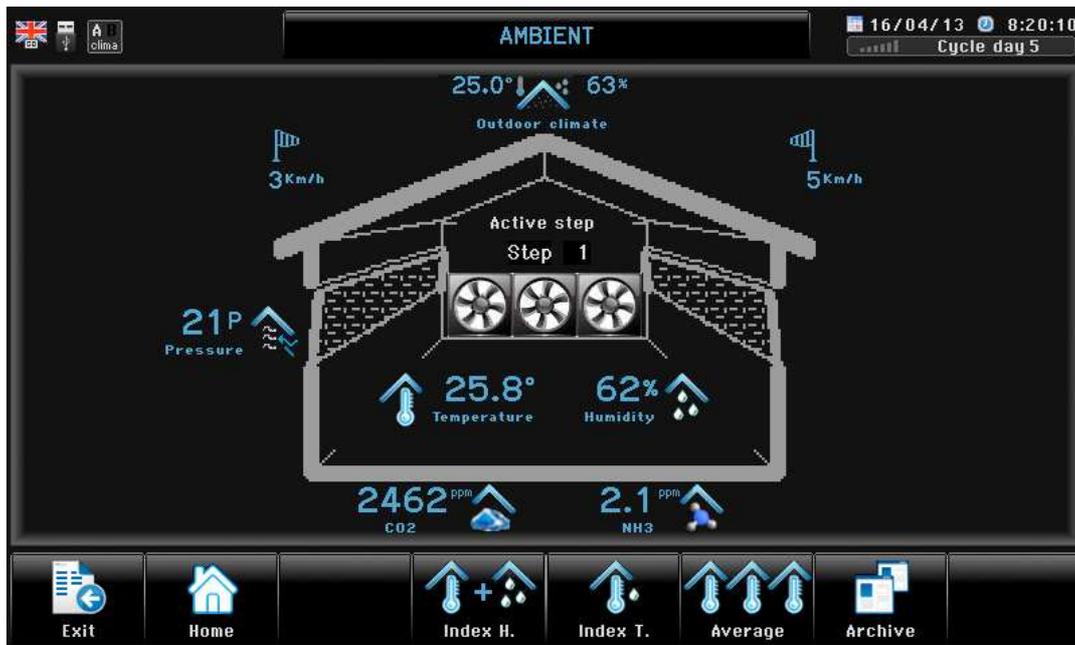

### **Ventilation**

Up to 16 x independent and fully configurable ventilation steps according to following typical options:

- On / Off.
- Fan speed control by transformer.
- Proportional by 0 -10 V for triac / inverter speed control.
- Or a combinations of the three systems above.

*The calculation of the minimum ventilation can be handled in two separate ways:*

### **Normal Ventilation**

Below a required minimum value ventilation is handled by timer to ensure minimum ventilation rate. If indoor temperature becomes higher, ventilation is increased accordingly. In case of On-Off ventilation on step 0, air changes can be activated. They are automatically calculated by timer and optimized to give minimum heating consumption and optimal air exchange.

Working fans position can also be cyclically rotated during the air changes (during normal working conditions the last fan can be cyclically rotated).

### **M<sup>3</sup>/h/Kg Ventilation**

Below a required minimum value ventilation is handled according to M<sup>3</sup>/h/kg so according to number of birds, weight of birds and the M<sup>3</sup>/hour per Kg live weight parameter.

While working by this mode, number of birds must be kept strictly updated and at cycle start up all relevant parameters must be inputted.

When fans are working in on-off mode, the system operates them by timer by cyclically shifting thru the fans of each step.

In case fans are working by 0-10V regulation, the system works in "saw tooth" mode by increasing the fan speed gradually to reach 100% and then switching to the next fan (keeping previous fan at full speed).

This system particularly fits small diameter ventilation systems as one fan only is working by speed regulation. Fans can also be operated cyclically.

## Qfarm can manage environmental control



### Air Flaps

Up to 16 x independent air flaps according to following typical options:

#### Dynamic ventilation systems

- Pressure drop (thru the **DP59/W** pressure drop control module).
- Pressure drop + potentiometer to align air inlets to same degree of opening (thru the pressure drop control module + potentiometer).
- Delta T= depressiometer with potentiometer alignment of the flaps and with zone temperature probe (the Flap is controlled by the depressiometer and the temperature probe acts if, between two or more Flaps, the temperature difference exceeds a certain value of Delta t).
- Proportional according to ventilation steps (while increasing ventilation, air inlet open proportionally) with potentiometer.

#### Natural ventilation systems

- Floating or Derivative (no potentiometer).
- Proportional (by potentiometer or by 0 -10V).
- Aligned (with flaps feedback potentiometer): it allows to align this flap to another flap controlled by potentiometer.

#### Emergency:

- Flap is closed in normal working conditions. It opens up only as emergency unit.


### Cooling

Controls of 2 cooling systems by temperature and % RH.

### Humidification

Humidification according to temperature and % RH.

## Qfarm can manage environmental control

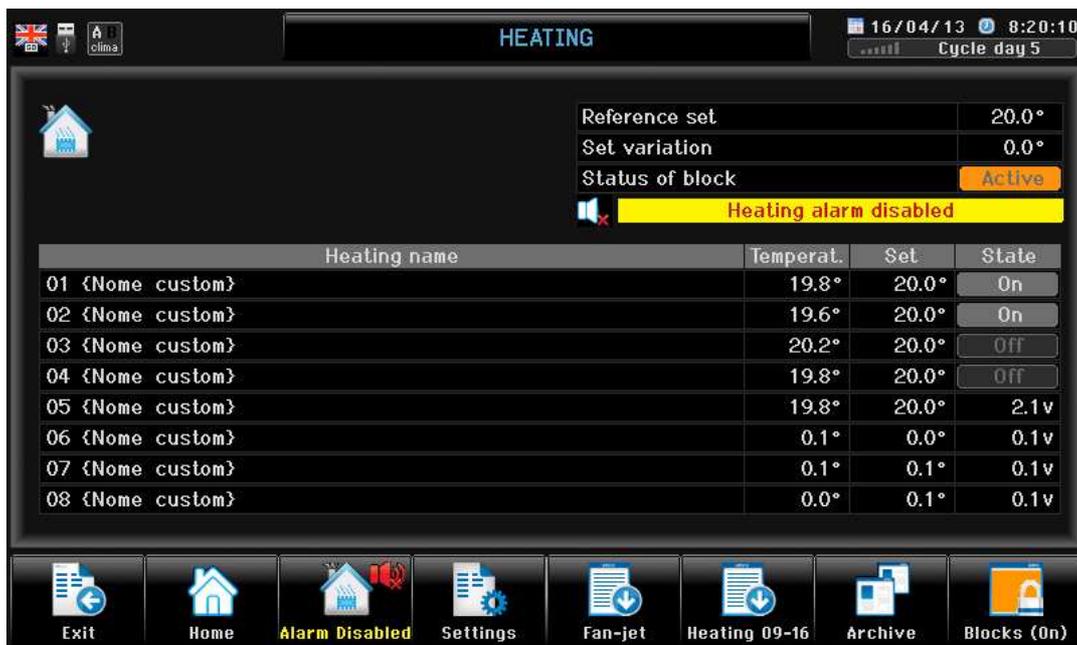

Heating name	Temperat.	Set	State
01 {Nome custom}	19.8°	20.0°	On
02 {Nome custom}	19.6°	20.0°	On
03 {Nome custom}	20.2°	20.0°	Off
04 {Nome custom}	19.8°	20.0°	Off
05 {Nome custom}	19.8°	20.0°	2.1v
06 {Nome custom}	0.1°	0.0°	0.1v
07 {Nome custom}	0.1°	0.1°	0.1v
08 {Nome custom}	0.0°	0.1°	0.1v

### Heating

- 16 ON-OFF or 0-10V heaters (also a combination of them up to 16 heaters).
- 4 Fan-jet destratifiers
- 1 Modulant output radiant heater or 1 x two stages automatic ignition radiant heater.

### Heat index

Qfarm can also work according to the heat index, which is related to the temperature “felt” by the birds (according to the Temperature - Relative Humidity correlation).

### Average temperature value

Up to 4 probes can be connect to measure the indoor ventilation temperature. These probes, alongwith the heating and the flaps probes can be connected to create an “average” temperature value as a mix of the temperatures as recorded by the above probes.


### Calendar

Heating and ventilation options can be set to run automatically according to the day of the batch.

### Password

Up to 2 password levels can be set by the system administrator so to prevent misuse of unit.

# Qfarm can manage environmental control

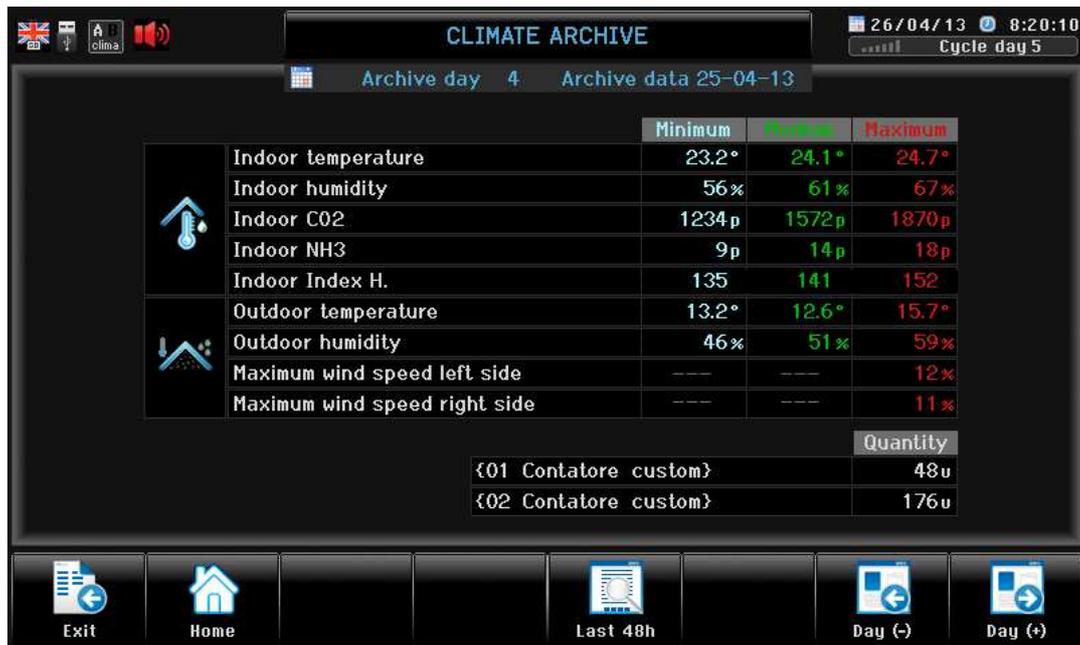

## Qfarm can manage alarms control



### Alarms

Temperature, humidity, air-pressure, CO<sub>2</sub>-NH<sub>3</sub>, minimum amper absorption, recording all the alarm events (including alarm exclusions).

### Alarm test

The general alarm output (built-in on **Qfarm**) can be tested both manually and automatically.

The **manual test** allows for example, to test the alarms sirens of each shed.

In this case the manual test duration will be set at smaller value than the delay in sending the signal to the automatic phone dialer.

The **automatic test** allows to test the whole alarm transmission circuit.


In this case the automatic test duration will be set at longer value than the delay in sending the signal to the automatic phone dialer.

It's possible to set the days of the week when to perform the automatic test.

### HP29/W independent alarm

Independent ventilation alarm unit which is a supplementary source of the following alarm:

- Minimum and maximum temperature.
- Minimum and maximum air-pressure.
- Check of **GT Farm** correct functions by a signal sent every 6 min (watchdog).

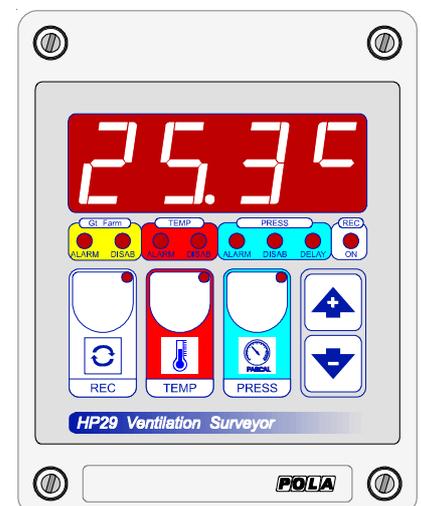

# Qfarm and the 2007/43/CE Directive (animal wellness)

Besides the complete management of the climate (fans, air inlets, heating and cooling systems) and the feed supply some of the **Qfarm** features are already oriented to comply with "animal wellness" norms.

- > **Light control.** Management of darkness periods.
- > **Birds archive** ( present, dead, taken away for each day of cycle).
- > **"Daily inspections" archive**  
by keyboard confirmation the system archives data and hours of the operator inspection, so that the 2 mandatory daily inspections are recorded.

	Females	Males
Present	12124	10167
Removed	0	0
Introduced	0	0
Dead	0	0
Culled for legs problems	0	0
Culled for other problems	0	0

## Moreover, to have higher densities:

- > **Alarm system.** In case of computer or electronic devices failures (**HP29/W**).
- > **Conditioning of ventilation according to relative humidity**, to make sure relative humidity does not go beyond a critical value.  
Besides the daily archives of all day of cycle there are archives of the last 48 hours (measurements every 30 min) of:

	Minimum	Current	Maximum
Indoor temperature	23.2°	24.1°	24.7°
Indoor humidity	56%	61%	67%
Indoor CO2	1234p	1572p	1870p
Indoor NH3	9p	14p	18p
Indoor Index H.	135	141	152
Outdoor temperature	13.2°	12.6°	15.7°
Outdoor humidity	46%	51%	59%
Maximum wind speed left side	---	---	12%
Maximum wind speed right side	---	---	11%

- Indoor and Outdoor temperature
- Indoor and outdoor Relative Humidity
- CO2 and NH3 outdoor.


- > **Air changes according to the M3/H/Kg parameter.**  
Air changes and minimum ventilation rate can be calculated according to the number of birds and their weight and the M3/h/Kg factor.

Ventilation details		m3/h Ventilation	
Active step	0% 0	Supplied ventilation	12.4%
Ventilation step	25.0°	Minimum calculation	8.0%
Set variation	0.0°	Supplied m3	5600m3
Status of block	Active	System total m3	640000m3
Current ventilation	ClimaLe A	Present females	12124
Exchange air	On	Weight of females	37gr
0-10 Volt ventilation	1.3v	Present males	10167
Dehumidification set	80%	Weight of males	43gr
		m3/h/Kg factor	0.90


## > Cycle data Archive.

All significant data can be archived and exported into various formats (i.e. Excel format).

Base Date	Pesi (g)	Pesa1 (g)	Pesa2 (g)	Pesa3 (g)	Pesa4 (g)	Pesa5 (g)	Pesa6 (g)	Pesa7 (g)	Pesa8 (g)	Pesa9 (g)
1 16/09/10	Fa	42	58	46	276	0	1	108		
2 17/09/10	Fa	42	59	47	289	0	1	108		
3 18/09/10	Fa	42	59	47	299	0	1	108		
4 19/09/10	Fa	42	59	47	306	0	1	108		
5 20/09/10	Fa	41	59	47	308	1	2	108		
6 21/09/10	Fa	41	59	46	308	0	1	108		
7 22/09/10	Fa	41	59	46	327	0	1	108		
8 23/09/10	Fa	41	59	46	352	0	1	108		
9 24/09/10	Fa	168	194	35	134	157	283	74		
10 25/09/10	Fa	168	194	35	135	157	283	74		
11 26/09/10	Fa	241	293	12	47	49	1454	62		
12 27/09/10	Fa	267	302	1	14	42	1563	69		
13 28/09/10	Fa	335	311	14	45	42	1527	71		
14 29/09/10	Fa	377	346	32	64	47	1562	72		
15 30/09/10	Fa	407	386	35	65	49	1622	72		
16 01/10/10	Fa	431	405	19	42	49	1622	76		
17 02/10/10	Fa	520	509	12	24	49	164	75		
18 03/10/10	Fa	557	563	3	16	62	149	79		
19 04/10/10	Fa	627	619	19	23	61	167	76		
20 05/10/10	Fa	698	675	14	21	62	169	79		
21 06/10/10	Fa	750	730	20	23	61	169	76		
22 07/10/10	Fa	804	760	15	19	64	172	79		
23 08/10/10	Fa	872	847	25	30	61	181	76		
24 09/10/10	Fa	942	905	36	40	70	205	81		
25 10/10/10	Fa	1022	964	40	50	70	202	81		
26 11/10/10	Fa	1095	1027	42	41	63	193	82		
27 12/10/10	Fa	1164	1080	42	42	63	189	80		

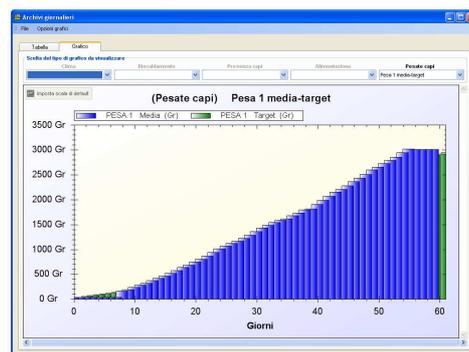

## Qfarm can manage feeding control

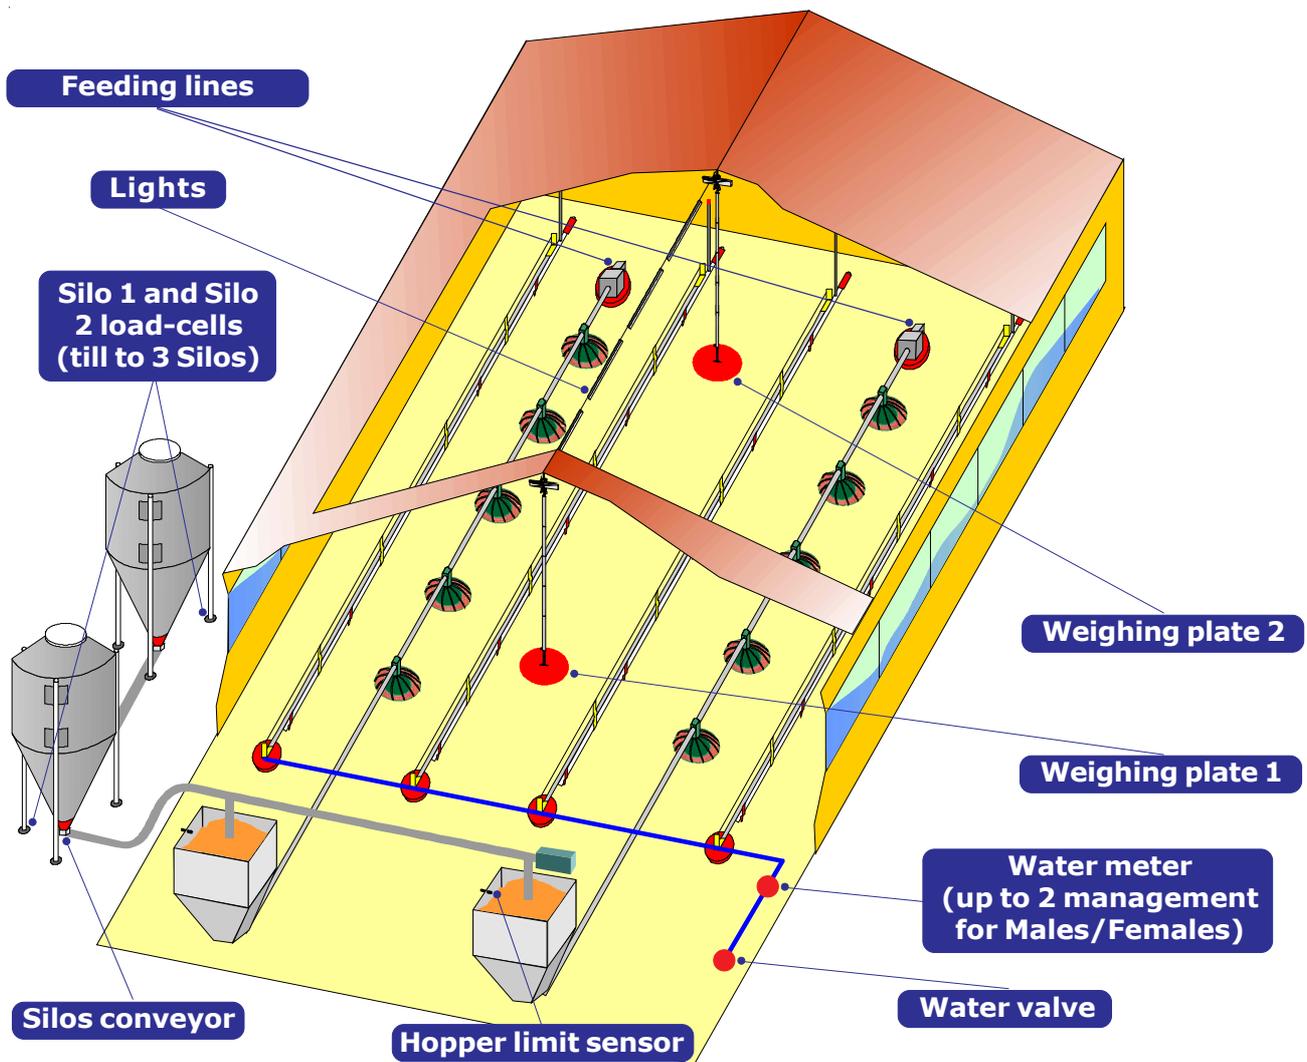

A daily quantity of feed (limited or unlimited) is distributed, according to the feeding curve at preset times of day.

Feed management can be done either by the silos load cells (till to 3 silos) or by volumetric system (when silos have no load cells) by converting the auger working time into Kg, or by an external weighing system (i.e. a mechanical weigher).

*Feed distribution can be done in 2 ways:*

- **Unlimited.** NO limit of weight and time. **Qfarm** manages the feed distribution, records all relevant feeding data and the birds weighings.
- **Limited.** Distribution is done at preset times according to preset parameters (gr./ birds x nr. of birds). This operation is performed until the programmed daily food weight has been reached.

The program records the number of birds so that the daily meal curve is set in gr/birds (the curve can be temporarily changed without losing original data and settings of original curve).

The program also manages the water distribution controlling the water-meter.

In the archives (managed on a daily basis) are recorded all the data related to the day meal, bird weight, silos upload/download and birds performances.

# Qfarm can manage feeding control



## Animals accounting

Daily recording of inputted, taken away, dead birds.

## Birds weighing

Bird weighing is performed by the 2 weighing plates (1 plate available as option).

## Feed

Feed management can be done either by the silos load cells (till to 3 silos) or by volumetric system (when silos have no load cells) by converting the auger working time into Kg. Silo conveyor command, feeding line, mangers lift up and down, light, water.

## Water management

Water distribution is programmable at preset times and consumption is recorded by the water meter. Water level is kept under constant control to prevent problems.

## Lights

Qfarm can control light with control up to 8 lights (by On / off output and with dawn / sunset 0-10V output), can also control the opening and closing of hens nests.



# Qfarm can manage feeding control

## **Silos weighing: How to control the feed weight. By volumetric or by load cell system ?**

### **Volumetric system**

This systems allows the feed weight control by counting the working time of the silos auger and converting it in Kg of feed. This requires a calibration procedure (to be run every time the feed density is different from previous supplies):


**Qfarm** runs the auger by 30 sec then check how many Kg were downloaded and convert the feed/time ration into a "K" factor.

#### *Advantages:*

- No load cells are required.

#### *Disadvantages:*

- The accuracy of system depends on the accuracy of calibration and K factor.
- The alarm "Stock/meals" (how many meals are contained in the silos) cannot be activated.

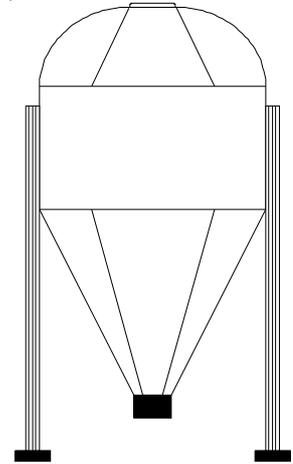

### **Load cells System**


This system makes a direct measurement of feed contained in the silos by the load cell (till to 3 silos) which are located under each silos leg.

#### *Advantages:*

- Total quantity of feed in the silos can be displayed weighing measurement is very accurate Alarm "Stock/meals" can be activated.

#### *Disadvantages*

- Load cells installation is required.

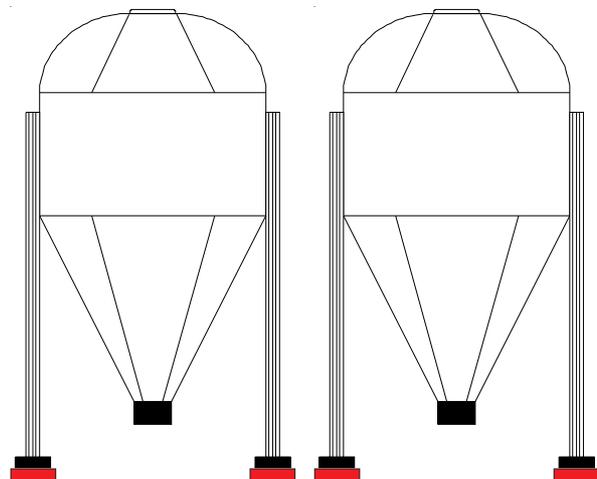



**Till to 3 silos**

# Qfarm can manage feeding control

## Load cells System

### HP63/W Silos weight repeater

**HP63/W** is a repeater of the silos weight (IP55 insulated unit) so the value can be easily read near the silos. It has been designed for outdoor installation and 1 units can be connected for each silos (till to 3 silos). It can be connected to the 485 weight bus, available on the **TLC2** loadcells amplifier located near the silos.

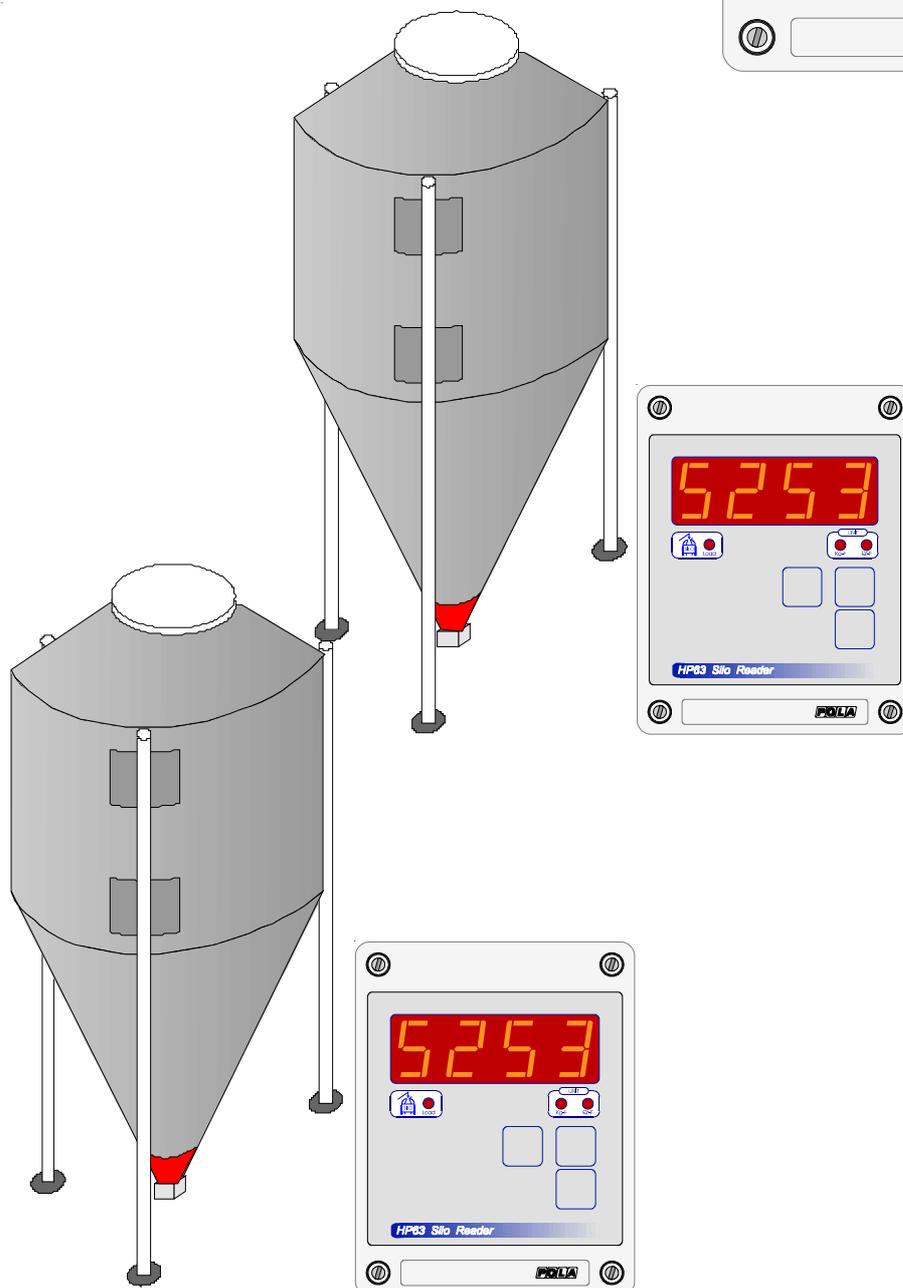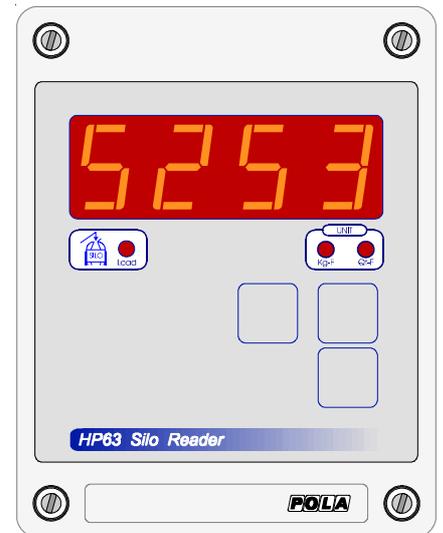

Till to 3 silos

# Qfarm can manage feeding control

## Light management for broilers

Specific features of this light system are:

Command 1 ambient lights with on/off output.


Command 1 ambient lights with dawn/sunset function (by 0-10V output).

## Light management for ground hens


Command up to 8 ambient lights with dawn/sunset function (by 0-10V output).

Command opening / closing nests.


Command eggs collection timer (free timer 1).

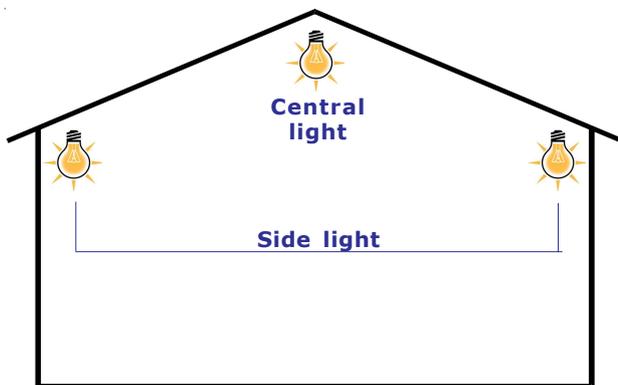

**Command 2 ambient lights**  
with dawn/sunset function

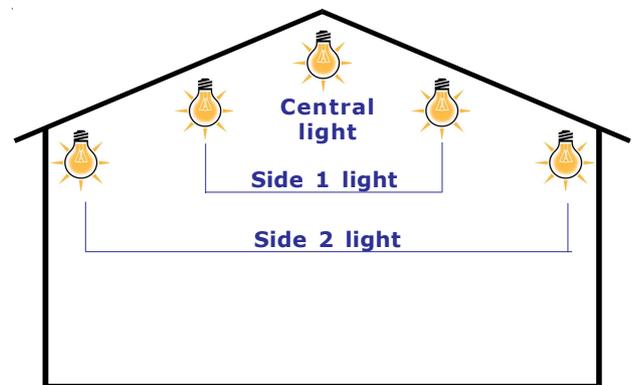

**Command 3 ambient lights**  
with dawn/sunset function

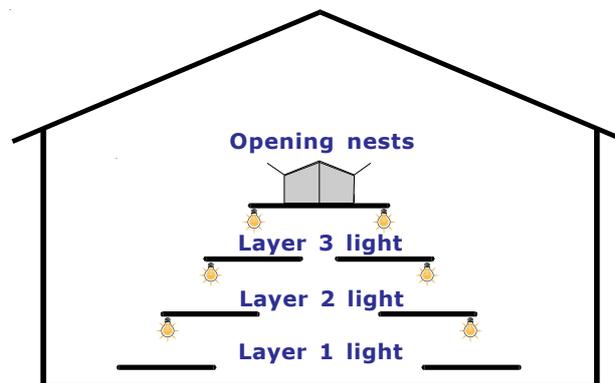

**Command 3 layers lights with on/off output**  
and command opening / closing nests

## Fast period

This procedure allows to program in advance day and hours of fast starting. This is usually done when reducing number of birds or on last day of cycle.

At fast start up, silos spyral and feeding lines are switched off. Lights are switched on (if required). Water is turned on (during off hours). After some time feeding line can be started on again for some time to empty the system.

## Medicated water


### **Setting of medication:**

The procedure sets the liters of medicated water and confirms ther start up of medication.

### **Medicated working:**

when starting the medication mode, the **Water line** valve will be closed and the **Fill Medication tank** is kept open until the tank has reached the required level.

The water pump works until is switched off by the tank level sensor (**Sensor medication tank**) then the pump (**Empty Medication tank**) is switched off and the **Water line** valve is opened again.

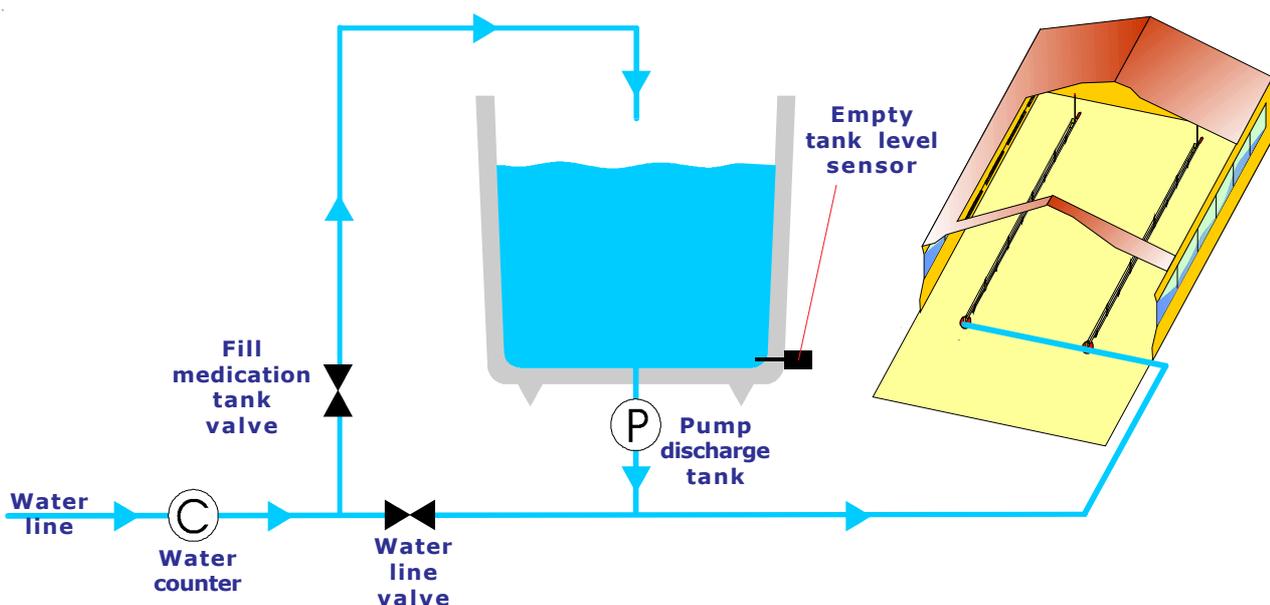

# Qfarm can manage feeding control


## Why an oscillating weighing plate ?

### Better weighing accuracy:

- The plate can be adjusted to be close to the litter so birds can easily jump on it.
- The oscillating plate prevents birds to stay too long on the plate (or even to get sleep on it) reducing the number of daily measurements.
- The multiple weight system captures all the birds which are on the plate.
- The round plate (diam 76 for chicks and 98 for turkeys) makes easy for birds to jump on it.

### Less installation and maintenance problems:

- The connecting cable is NOT on the floor, preventing wear off and cuttings.
- The load cell is well protected from moisture and dust.
- The mechanical part of the weighing system is easily removed at end of cycle.
- It well visible in the shed, preventing bumps and crashes.
- Any height can be reached by adding extensions.
- Load cell is easily at reach and easy to be serviced.

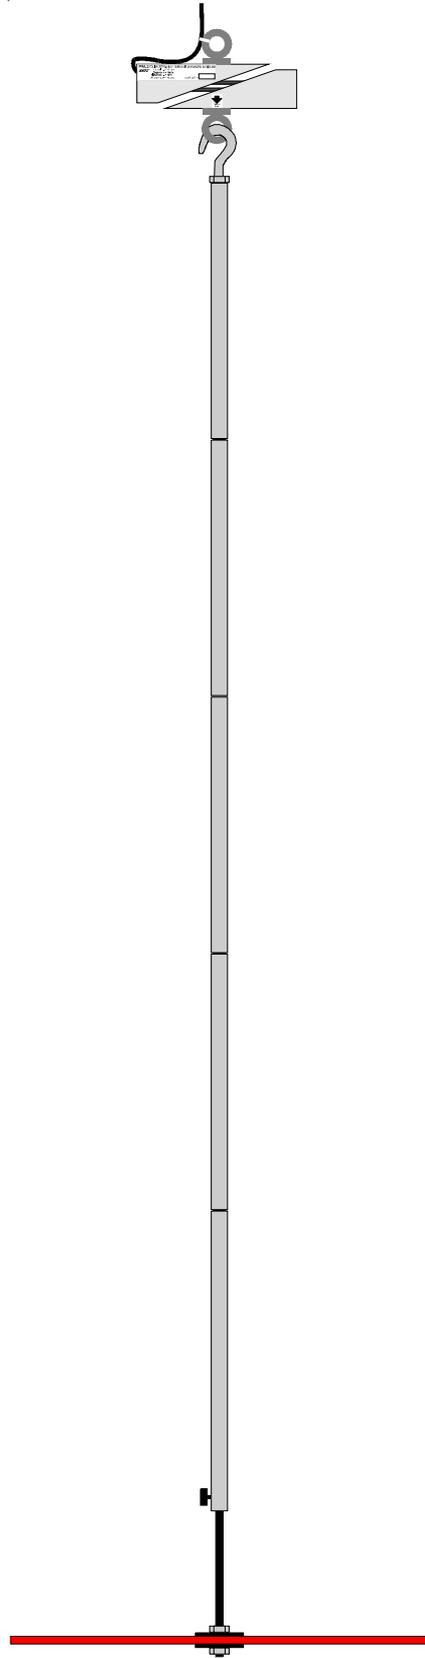


## Qfarm can manage feeding control


### Why two plates per shed ?

Even if one good weighing plate system can do the work, still there are some good reasons to install two plates:

- In case of mixed cycle (males and females) you get an accurate average measurement all along the shed.  
When the females are taken away, the second plate is automatically converted into a 2nd males plate so the measurement is more accurate as males birds which take the place of females are already used to the plate.
- In a " All males" cycle (All females) 2 plates reduce the weight difference which exists from different sectors of shed.

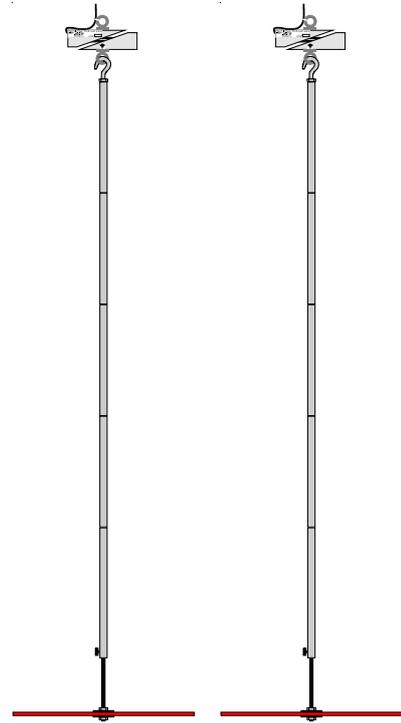

When 2 plates are installed we advise to locate them as per above figure

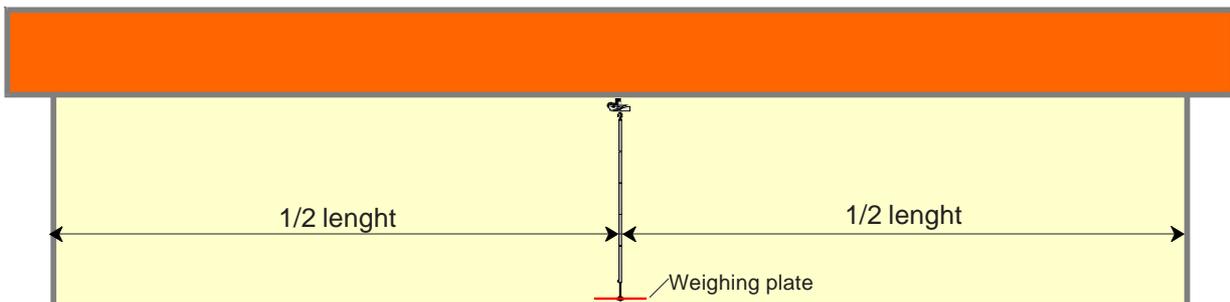



When 1 plate is installed, we advise to install it in the middle of shed

# Qfarm can manage feeding control




## Weighing plate

PWS1s plate for chicks
Load capacity= 30 Kg
Plate diameter= 76 cm
Lenght= 310 cm
Insulation= IP54

PWS2 plate for turkeys
Load capacity= 30 Kg
Plate diameter= 98cm
Lenght= 380 cm
Insulation= IP54

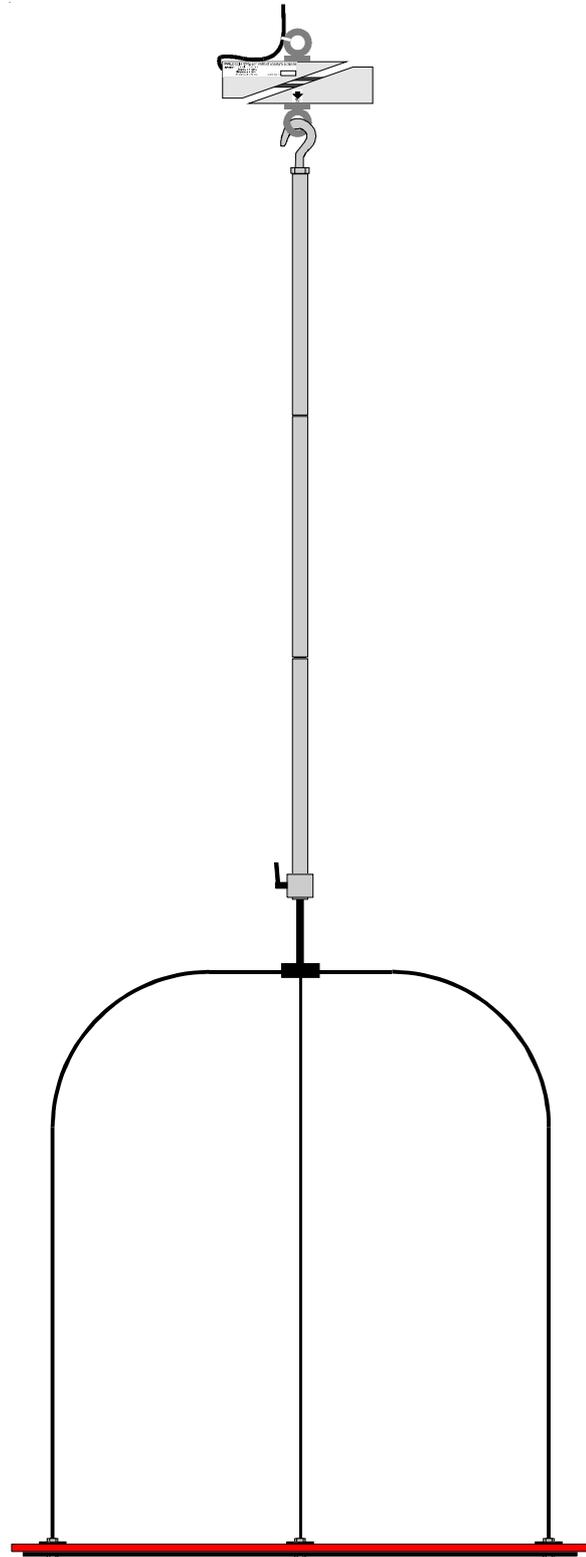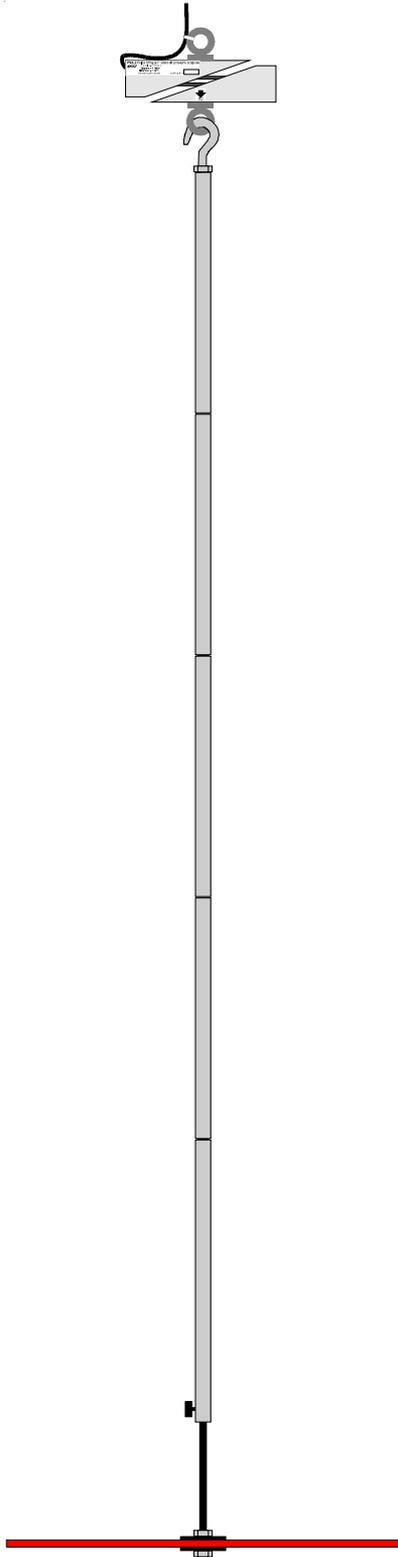

# Qfarm Farm can manage feeding control

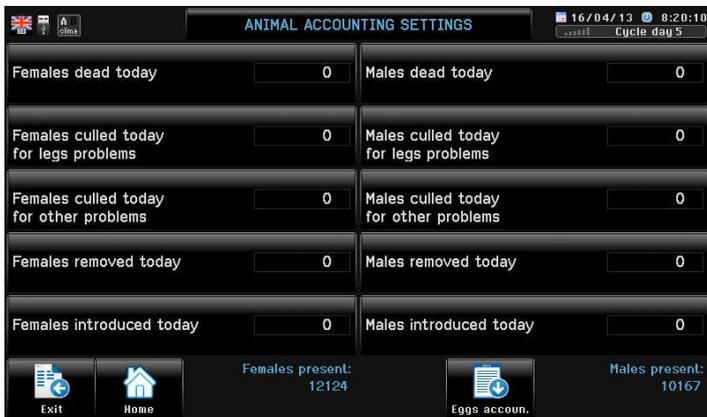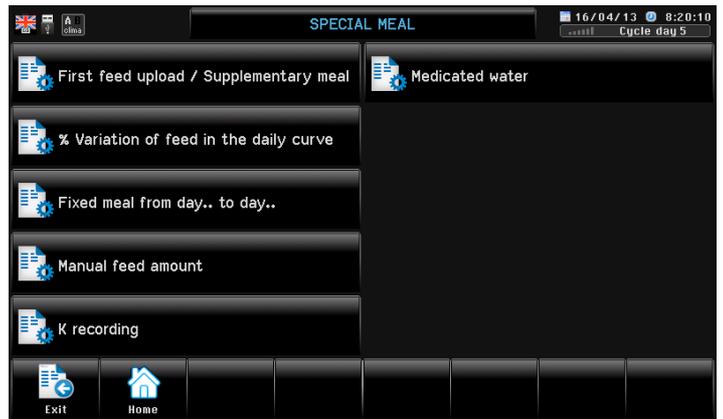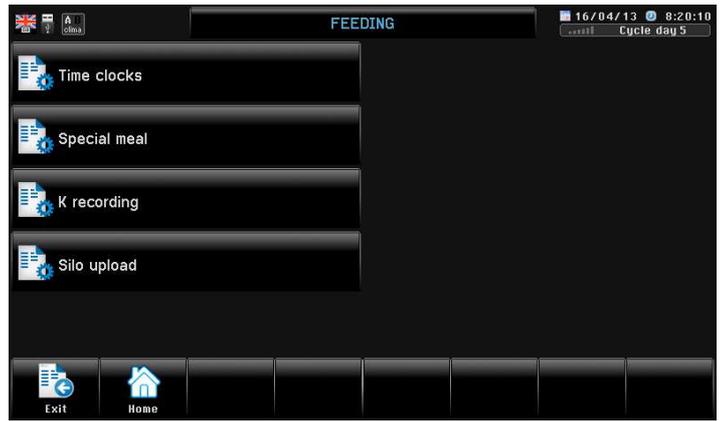

# Qfarm stores in archives all the data of the cycle

### CLIMATE ARCHIVE

Archive day 4 Archive data 25-04-13

	Minimum	Average	Maximum
Indoor temperature	23.2*	24.1*	24.7*
Indoor humidity	56%	61%	67%
Indoor CO2	1234p	1572p	1870p
Indoor NH3	9p	14p	18p
Indoor Index H.	135	141	152
Outdoor temperature	13.2*	12.6*	15.7*
Outdoor humidity	46%	51%	59%
Maximum wind speed left side	---	---	12%
Maximum wind speed right side	---	---	11%

	Quantity
{01 Contalore custom}	48u
{02 Contalore custom}	176u

Exit Home Last 48h Day (-) Day (+)

### HEATING ARCHIVE

Archive day 4 Archive data 25-04-13

	Minutes		Minutes
01 {Nome risc. custom}	253'	09 {Nome risc. custom}	0'
02 {Nome risc. custom}	146'	10 {Nome risc. custom}	0'
03 {Nome risc. custom}	231'	11 {Nome risc. custom}	0'
04 {Nome risc. custom}	0'	12 {Nome risc. custom}	0'
05 {Nome risc. custom}	0'	13 {Nome risc. custom}	0'
06 {Nome risc. custom}	0'	14 {Nome risc. custom}	0'
07 {Nome risc. custom}	0'	15 {Nome risc. custom}	0'
08 {Nome risc. custom}	0'	16 {Nome risc. custom}	0'

	Minutes		Minutes
Radiant minimum working time	157'	Total time Heating 1...16	630'
Radiant maximum working time	46'		

Exit Home Day (-) Day (+)

### FEEDING ARCHIVE

Archive day 4 Archive data 25-04-13

Feed		Water	
Programmed feed	AL will	Programmed water	AL will
Distributed feed	612Kg	Distributed water	1234lt
Distributed Gr/bird feed	70Gr	Distributed water Gr/bird	141Gr
Females programmed curve Gr/bird	9999Gr	Programmed water Gr/bird	9999Gr
Males programmed curve Gr/bird	9999Gr	Water meal programmed time	02:05'
Feed meal programmed time	02:05'	Water meal distribution time	02:05'
Feed meal distribution time	02:05'	Programmed Water/Feed	0.00
Light switching total time	05:44'	Distributed Water/Feed	2.01
Supplementary meal	0Kg	Line 1 distributed Water/Feed	52%
Meal variation	0%	Line 2 distributed Water/Feed	48%
Fixed meal	No	Conversion	1.76
Manual feed supply	0Kg		
Down. silo 1	612Kg	Down. silo 2	0Kg

Exit Home Graphics Day (-) Day (+)

### BIRD WEIGHING ARCHIVE

Archive day 4 Archive data 25-04-13

	Plate 1	Plate 2	AVERAGE
Average today	54Gr	64Gr	59Gr
Target weight	54Gr	64Gr	
Target deviation	0Gr	0Gr	
% Target deviation	0.0%	0.0%	
Daily increase	6Gr	12Gr	
Number of weighing	1432	1322	
Uniformity	90%	90%	

Exit Home Graphics Day (-) Day (+)

### ANIMALS PRESENT ARCHIVE

Archive day 4 Archive data 25-04-13

	Females	Males
Present	12124	10167
Removed	0	0
Introduced	0	0
Dead	0	0
Culled for legs problems	0	0
Culled for other problems	0	0

Exit Home Birds archive Eggs archive Day (-) Day (+)

### SILO UPLOAD ARCHIVE

Archive day 4 Archive data 25-04-13

Silo upload done	Date	Hour
Silo 1 upload	11012	18-03-13 16:02
Silo 2 upload	13212	18-03-13 15:37
Silo 3 upload	9432	18-03-13 14:54
Silo 1 upload	1023	15-02-13 18:15
Silo 2 upload	11789	15-02-13 17:48
Silo 3 upload	13480	15-02-13 17:18
Silo 1 upload	7649	11-01-13 13:58
Silo 2 upload	8572	11-01-13 13:26

Exit Home Up page Down page

### DAILY INSPECTION ARCHIVE

Archive day 4 Archive data 25-04-13

To perform the 'Daily Inspection' press 'E' key.

Daily inspection	
Recording in the period (00:00 ... 11:59)	Performed at 07:36
Recording in the period (12:00 ... 23:59)	Not performed

Alarm working test	
Alarm working test recording	Performed at 07:39

Exit Home Daily inspect. Day (-) Day (+)

### FEEDING TOTALS (DISTRIBUTION)

Archive day 4 Archive data 25-04-13

Feeding		Silo 1 upload	
Conversion	1.80	Total upload	1610H
Feed total	60H	Total download	60H
Water total	120H	Silo 2 upload	
Water / Feed	2.01	Total upload	120H
Feed Gr / Bird	70Gr	Total download	0H
Water Gr / Bird	141Gr	Silo 3 upload	
		Total upload	0H
		Total download	0H

Bird weighing		Feed manually added	
Average weight 1	42Gr	Total feed manually added	0H
Average weight 2	52Gr		
Total average	47Gr		


Exit Home Distribution Bird account. Eggs collect.

# Qfarm stores in archives all the data of the cycle

## Data transfert

Communication with external world is by USB pen drive.

The main programming parameters, the archive downloads and software updates can be made by PC connection via the USB pen drive.

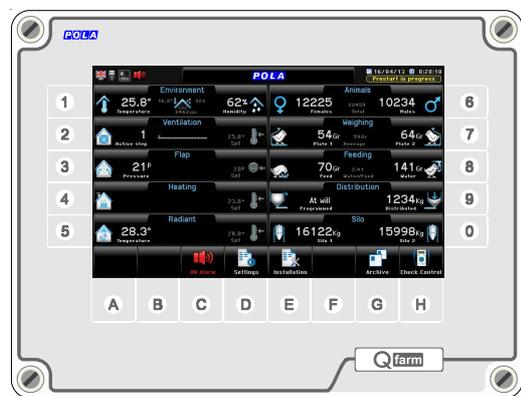

USB socket

# Configuration by P.C.

Ventilation table allocation

Table configuration setting Options Double climate system (A+B)

Main ventilation table (Climate A)

	Step 00	Step 01	Step 02	Step 03	Step 04	Step 05	Step 06	Step 07	Step 08	Step 09	Step 10	Step 11	Step 12
05 Flap	Emerg												
04 Flap	Emerg												
03 Flap	close	close	close	close	close	Press							
02 Flap	close	close	close	close	close	Press							
01 Flap	close	Press	Press	Press	Press	Open	close						
12 Relay	off	ON											
11 Relay	off	ON											
10 Relay	off	ON	ON	ON									
09 Relay	off	ON	ON	ON	ON								
08 Relay	off	ON	ON	ON	ON	ON							
07 Relay	off	ON	ON	ON	ON	ON	ON						
06 Relay	off	off	off	off	off	off	ON						
05 Relay	off	off	off	off	off	ON							
04 Relay	off	off	off	off	ON	off							
03 Relay	off	off	off	ON	off								
02 Relay	off	off	ON	off									
01 Relay	off	ON	off										

Project reference  
Project Name: Untitled  
Setup software: 0000 Ver. 00

Project type Open modality Previous window Next window

Ventilation's table (Qfarm Lab software)

Project options

Climate Options

Climate options Feeding options

Ambient heating  
8 N. Heater 01 Heater 02 Heater 03 Heater 04 Heater 05 Heater 06 Heater 07 Heater 08  
Type >>> On-Off On-Off On-Off On-Off 0-10V 0-10V 0-10V 0-10V  
Block >>>

Radiant heating  
No control Floating type Spark type

Cooling  
No control 1 Output 2 Output

Indoor humidity probe (ambient)  
No control 4-20 mA Psychrometer

Outdoor humidity probe (outside)  
No control 4-20 mA

Options  
 Outdoor temperature probe  PT Flap potentiometer (N.= 0)  
 DP59W Drop pressure control  WT1 Psychrometer water support

Ventilation conditioning  
1 Ventilation temperature probes (SX)  
 Inc. conditioning input contact  Dec. conditioning input contact  
 Climate A<=>B sel. input contact  Pollution input contact

Flap conditioning  
 HXMM two way wind meter controller  
 Inc. conditioning input contact  Dec. conditioning input contact  
 External flap block 1 contact  External flap block 2 contact  
 Air draft roof flap temp. probe 1  Air draft roof flap temp. probe 2

Alarm inputs  
 Magnetothermal switch activation  Alarm silent external switch  
 Generic overload switch 1  Generic overload switch 2

Climate optional alarm outputs  
 Climate optional relay alarm #1 (00 functions selected)  
 Climate optional relay alarm #2 (00 functions selected)  
 Climate optional relay alarm #3 (00 functions selected)

Additional alarm systems  
 HP29W Additional alarm control  HBAT+BA Battery and charger  
 HTA3 Amperometric controller

Project reference  
Project Name: Untitled  
Setup software: 0000 Ver. 00

Project type Open modality Previous window Next window

Plant option window (Qfarm Lab software)

The Settings which characterize the system (number and type of heating, number and type of flaps, ventilation's type, specifications of the feeding system, etc.) will be setted from PC and uploaded on **Qfarm** module by the **Qfarm Lab** software.

# Network connection

Qfarm..1

Qfarm..128



HLAN



Some typical screenshots of cycle analysis are available on network program.

**Registrazioni**

Visualizza grafici delle 24 registrazioni selezionate

È il stato selezionato un periodo di 24 registrazioni

Data registrazioni	Ora record	Tempi amb. (°C)	Umidità amb. (RH%)	Tempi sistema (°C)	Margine distrib. (g)	Acqua distribuita (lit)	Fosfo piatto 1 (ppm)	Fosfo piatto 2 (ppm)	Proteina piatto 1 (g/l)	Proteina piatto 2 (g/l)	Num. di Pes. #1 (N°)	Num. di Pes. #2 (N°)		
28/11/2004	09:15:00	16,6	81,5	6,8	1762	-	1350	17908	0	0	32	-7	0	0
28/11/2004	09:30:00	16,7	80,7	7,1	1801	+19	1328	17956	+48	0	0	0	0	0
28/11/2004	09:45:00	16,5	81,5	7,1	1888	+65	1621	17903	-53	0	0	0	0	0
28/11/2004	10:00:00	16,9	80,8	7,4	1892	+106	2012	17880	-33	0	0	0	0	0
28/11/2004	10:15:00	16,9	79,9	7,9	2091	+929	2912	0	12920	0	0	0	0	0
28/11/2004	10:30:00	16,7	80,7	7,6	2092	+1	2400	18005	+125	0	0	0	0	0
28/11/2004	10:45:00	16,8	80,8	7,7	2097	+5	2433	18079	+74	0	0	0	0	0
28/11/2004	11:00:00	16,9	80,8	8,1	2098	-1	2516	18103	+24	0	0	0	0	0
28/11/2004	11:15:00	16,7	81,5	8,2	2143	+47	2599	18118	+45	0	0	0	0	0
28/11/2004	11:30:00	17,1	81,8	7,9	2253	+110	2654	18073	-35	0	0	0	0	0
28/11/2004	11:45:00	18,0	82,5	7,9	2295	+42	2721	18052	-21	0	0	0	0	0
28/11/2004	12:00:00	16,8	80,8	8,0	2312	+163	2791	18105	0	0	0	0	0	0
28/11/2004	12:15:00	17,0	81,8	8,1	2450	+41	2859	18052	0	0	0	0	0	0
28/11/2004	12:30:00	17,0	83,4	8,4	2459	+3	2923	18140	+88	0	0	0	0	0
28/11/2004	12:45:00	17,5	80,8	8,2	2504	+45	2986	18075	-65	0	0	0	0	0
28/11/2004	13:00:00	16,9	83,5	8,4	2594	+90	3053	18093	+10	0	0	0	0	0
28/11/2004	13:15:00	17,0	81,8	8,4	2598	+4	3140	18134	+49	0	0	0	0	0
28/11/2004	13:30:00	16,8	80,8	8,4	2757	+159	3221	18112	-12	0	0	0	0	0
28/11/2004	13:45:00	16,9	81,7	8,3	2761	+4	3307	18107	-15	0	0	0	0	0
28/11/2004	14:00:00	17,2	81,9	8,9	2790	-1	3399	18100	-7	0	0	0	0	0
28/11/2004	14:15:00	16,8	82,5	8,7	2831	+71	3490	18081	-19	0	0	0	0	0
28/11/2004	14:30:00	17,0	81,8	8,9	2990	+190	3586	18051	-30	0	0	0	0	0
28/11/2004	14:45:00	16,9	79,4	8,7	3045	+55	3632	18095	+44	0	0	0	0	0
28/11/2004	15:00:00	16,8	80,7	8,5	3048	+4	3761	18010	-18	0	0	0	0	0
28/11/2004	15:15:00	16,7	73,3	8,4	3055	+6	3884	18056	-47	0	0	0	0	0
28/11/2004	15:30:00	16,3	74,3	8,4	3107	+112	3970	18029	-34	0	0	0	0	0
28/11/2004	15:45:00	16,3	74,7	8,3	3382	+175	4093	18108	-12	0	0	0	0	0
28/11/2004	16:00:00	16,3	69,7	8,1	3490	+47	4393	18094	-14	0	0	0	0	0

Le colonne con il simbolo "lit" rappresentano la variazione della grandezza rappresentata nella colonna di sinistra rispetto alle...

**Grafici Registrazioni IIX27**

TEMPERATURA AMBIENTE - ESTERNA

**Grafici Registrazioni IIX27**

MARGINE + ACQUA DISTRIBUITI

**Registrazioni interventi allarme nel capannone 1**

Data registrazioni	Ora registrazione	Tipo di azione registrata	Numero di capannone interessato	Processore Genius interessato	Descrizione del tipo di allarme registrato
07/12/2004	16:41:43	ON	1	HK27	Massima quantità acqua
07/12/2004	17:21:12	ON	1	HK27	Massima quantità acqua
14/12/2004	08:39:50	ON	1	HK27	Platto I guasto
20/03/2005	16:51:51	ON	1	HK27	Platto I TLC0-1
20/03/2005	16:51:51	ON	1	HK27	Platto I sovrappeso
20/03/2005	17:06:26	ON	1	HK27	Scorta pasti
20/03/2005	17:06:26	ON	1	HK27	Platto I TLC0-1
20/03/2005	17:06:26	ON	1	HK27	Platto I sovrappeso
20/03/2005	17:13:25	ON	1	HK27	Scorta pasti
20/03/2005	17:13:25	ON	1	HK27	Platto I TLC0-1
20/03/2005	17:13:25	ON	1	HK27	Platto I sovrappeso
10/10/2005	11:23:34	ON	1	HK50	Arana Input

I dati presenti nella tabella sono registrati solo quando il programma è in funzione e non sono quelli registrati dai singoli processori. Il numero massimo di registrazioni è pari a mille, dopodiché verranno eliminate le più vecchie.

