



CARROLL COUNTY WATER AUTHORITY

FIG. 8
MAR. 2013

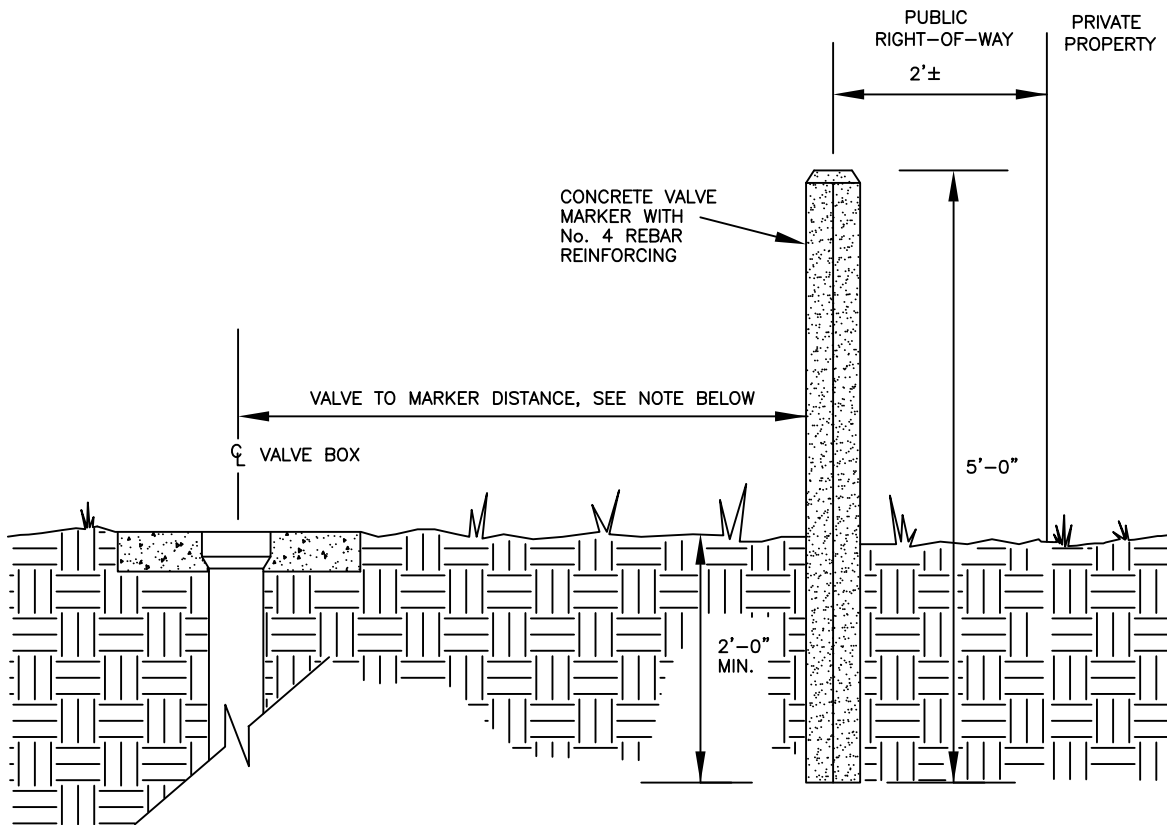

NOTE: AT CCWA ENGINEER'S DISCRETION, VALVE MARKERS TO BE SET FOR VALVES LOCATED ON STREETS WITHOUT CURBING, EXCLUDING FIRE HYDRANT ASSEMBLY VALVES.

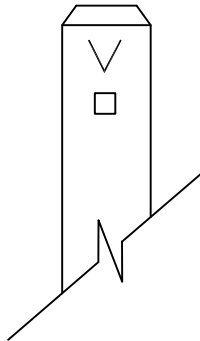

VALVE MARKER DETAIL